

DETAIL "A" - TYPICAL SHIELD/DRAIN INSULATING METHOD

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG'S E-1 AND E-2.
2. ALL SHIELDS SHALL BE ISOLATED FROM GROUND. APPROVED "SHRINK TUBING" SHALL BE USED ON ALL DRAIN CONDUCTORS. SEE DETAIL "A" (ON THIS DWG).
3. FOR NTC-1 ENCLOSURE LOCATION, SEE DWG E-5.

LEGEND

21UP5
21DN5

#14 AWG CONDUCTORS
21 - INDICATES PAIR
S - INDICATES SPARE
UP - INDICATES WIRE
DN - INDICATES WIRE
5 - INDICATES TERMINAL BLOCK

TB2 - TERMINAL BLOCK

(+) INDICATES POSITIVE


(-) INDICATES NEGATIVE

(R) INDICATES RED

(B) INDICATES BLACK

(S) INDICATES SHIELD

2 INDICATES TERMINAL BLOCK

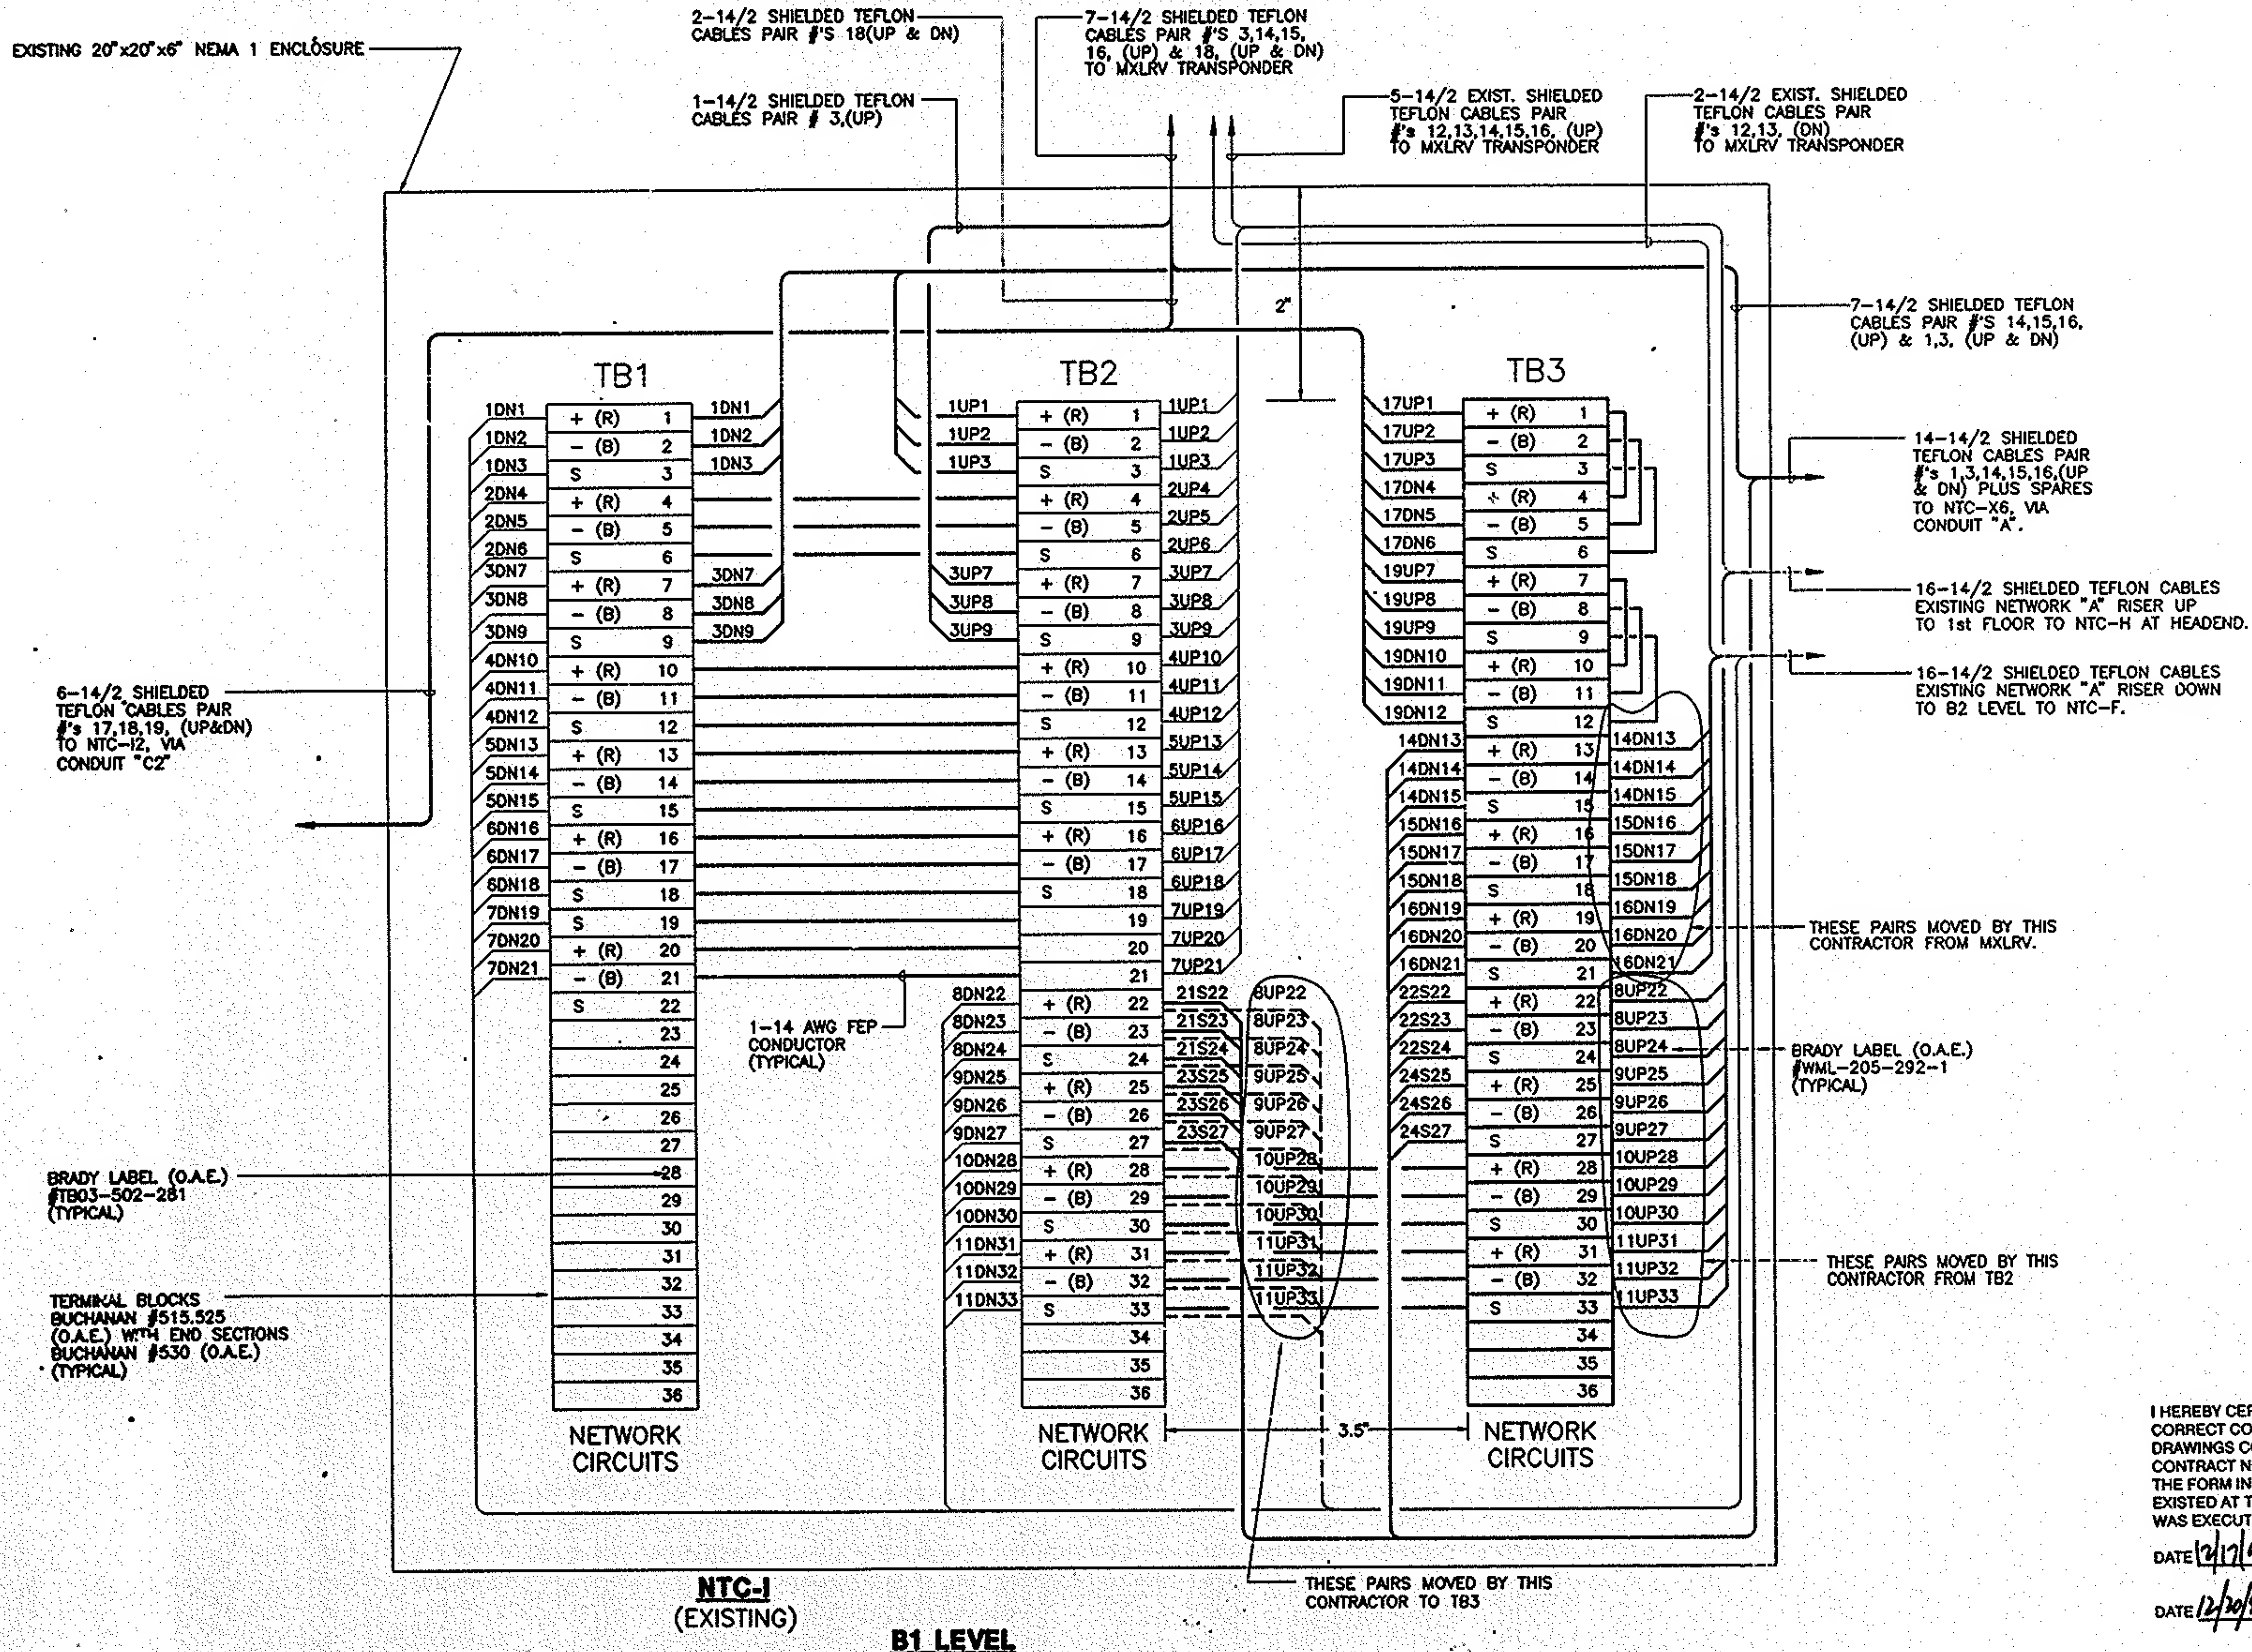

I HEREBY CERTIFY
CORRECT COPY OF
DRAWINGS CONSISTENT
CONTRACT NO. 100-
THE FORM IN WHICH
EXISTED AT THE TIME
WAS EXECUTED BY
DATE 12/17/99
DATE 12/17/99